

- LEGEND
- WATER LINE
 - SANITARY SEWER LINE
 - GAS LINE
 - STORM SEWER LINE
 - SOIL VAPOR LOCATION


NOTE: SOIL VAPOR RESULTS REPORTED IN UG/M³

APPROXIMATE LOCATION OF FORMER STREAM VALLEY

TCA	67.7
cis-1,2-DCE	3.26
Methylene Chloride	6.96
PCE	10.9
TCE	4.77

TCA	5.71
Methylene Chloride	3.81
PCE	15.9
TCE	39.3

TCA	27.7
cis-1,2-DCE	11.3
Methylene Chloride	6.67
PCE	2.28
Trans-1,2-DCE	2.22
TCE	3.98
TCA	5.21
Methylene Chloride	6.00
TCE	1.33

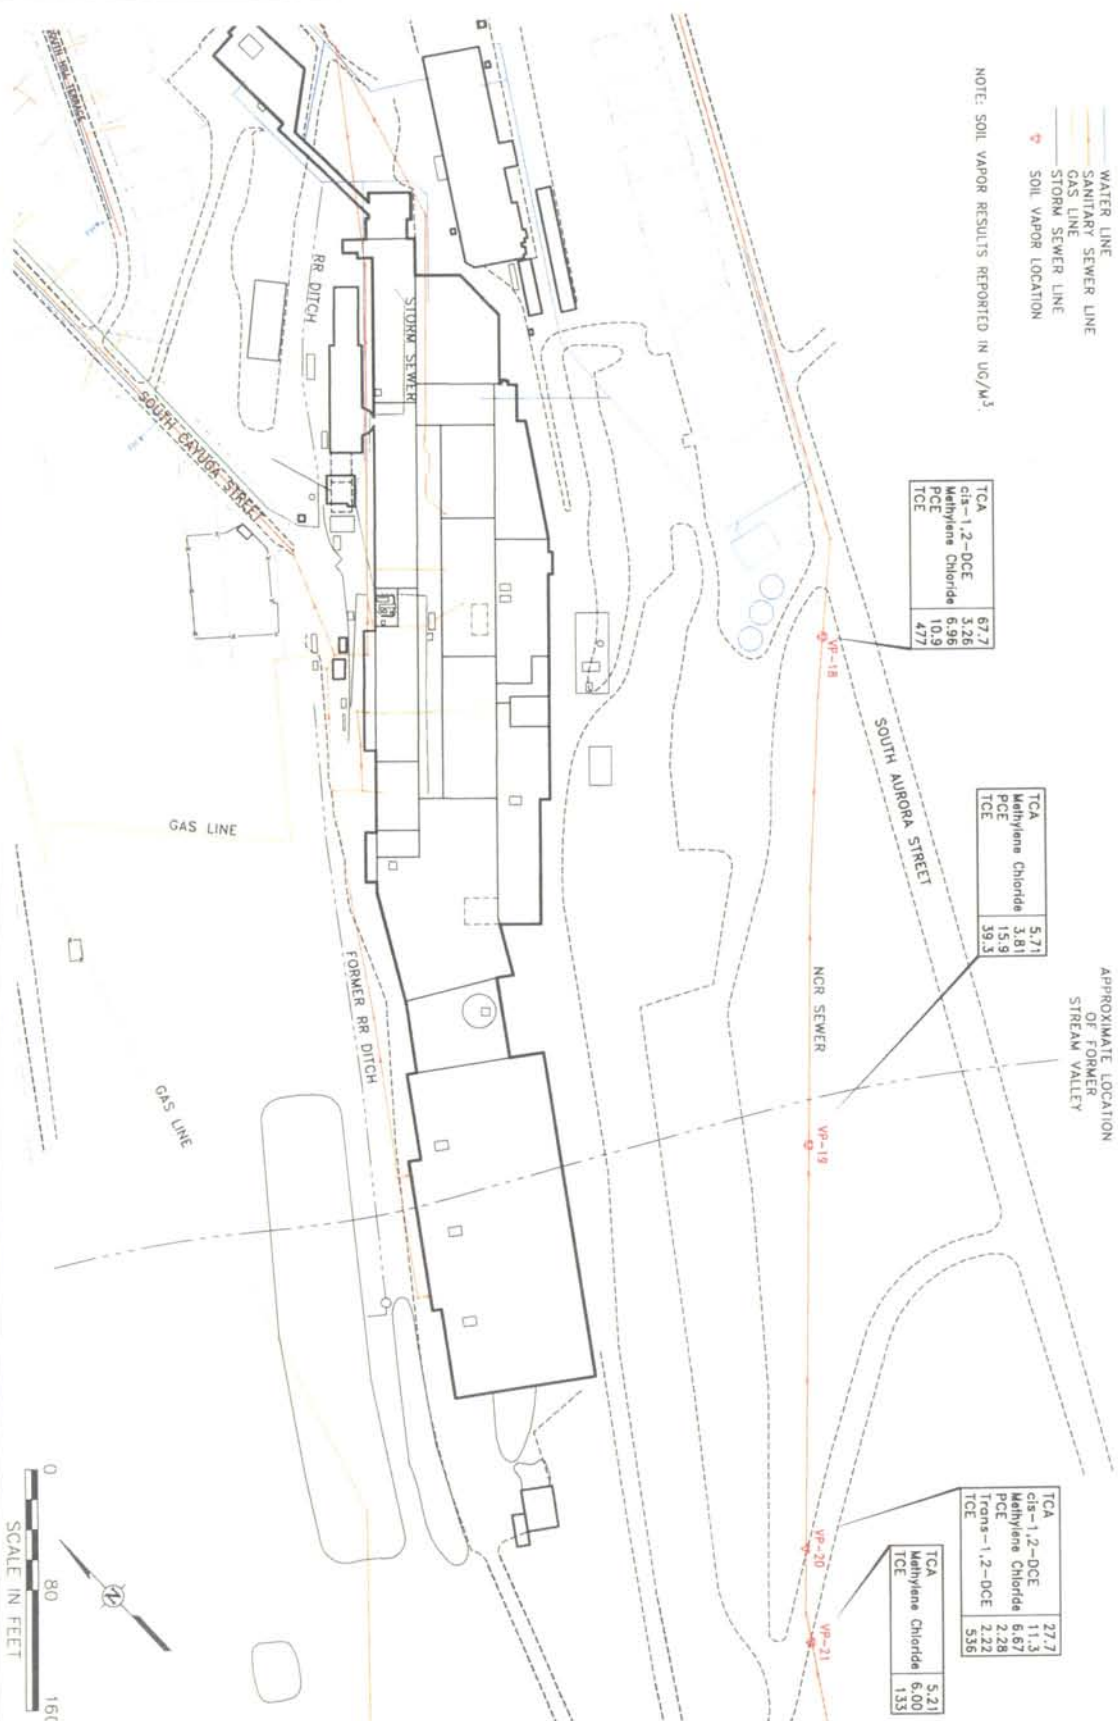

ENVIRONMENTAL STRATEGIES CONSULTING LLC
 11911 FREEDOM DRIVE SUITE 900
 RESTON, VIRGINIA 20190
 (703) 709-6500

Figure 1
 Soil Vapor Sampling Results - NCR Sewer Line
 Emerson Power Transmission
 Ithaca, New York